

IF IT IS FOUND DESIRABLE TO CHANGE ANY TOLERANCE OR OTHER DETAIL SPECIFIED ON THIS DRAWING NOTIFY THE PURCHASER PROMPTLY.
 MAXIMUM ALLOWABLE TOLERANCES HAVE BEEN DETERMINED AND DEVIATIONS WILL BE CAUSE FOR REJECTION. REMOVE ALL BURRS AND SHARP EDGES


RELEASED

NOTICE TO PERSONS RECEIVING THIS DRAWING

THE TECHNICAL MATERIEL CORPORATION claims proprietary right in the material disclosed herein. This drawing is issued in confidence for engineering information only and may not be re-produced or used to manufacture anything shown herein without permission from THE TECHNICAL MATERIEL CORPORATION to the user. This drawing is loaned for mutual assistance and is subject to recall at any time.

Property of:
 THE TECHNICAL MATERIEL CORPORATION
 MAMARONECK, NEW YORK

BOTTOM VIEW OF CABLE

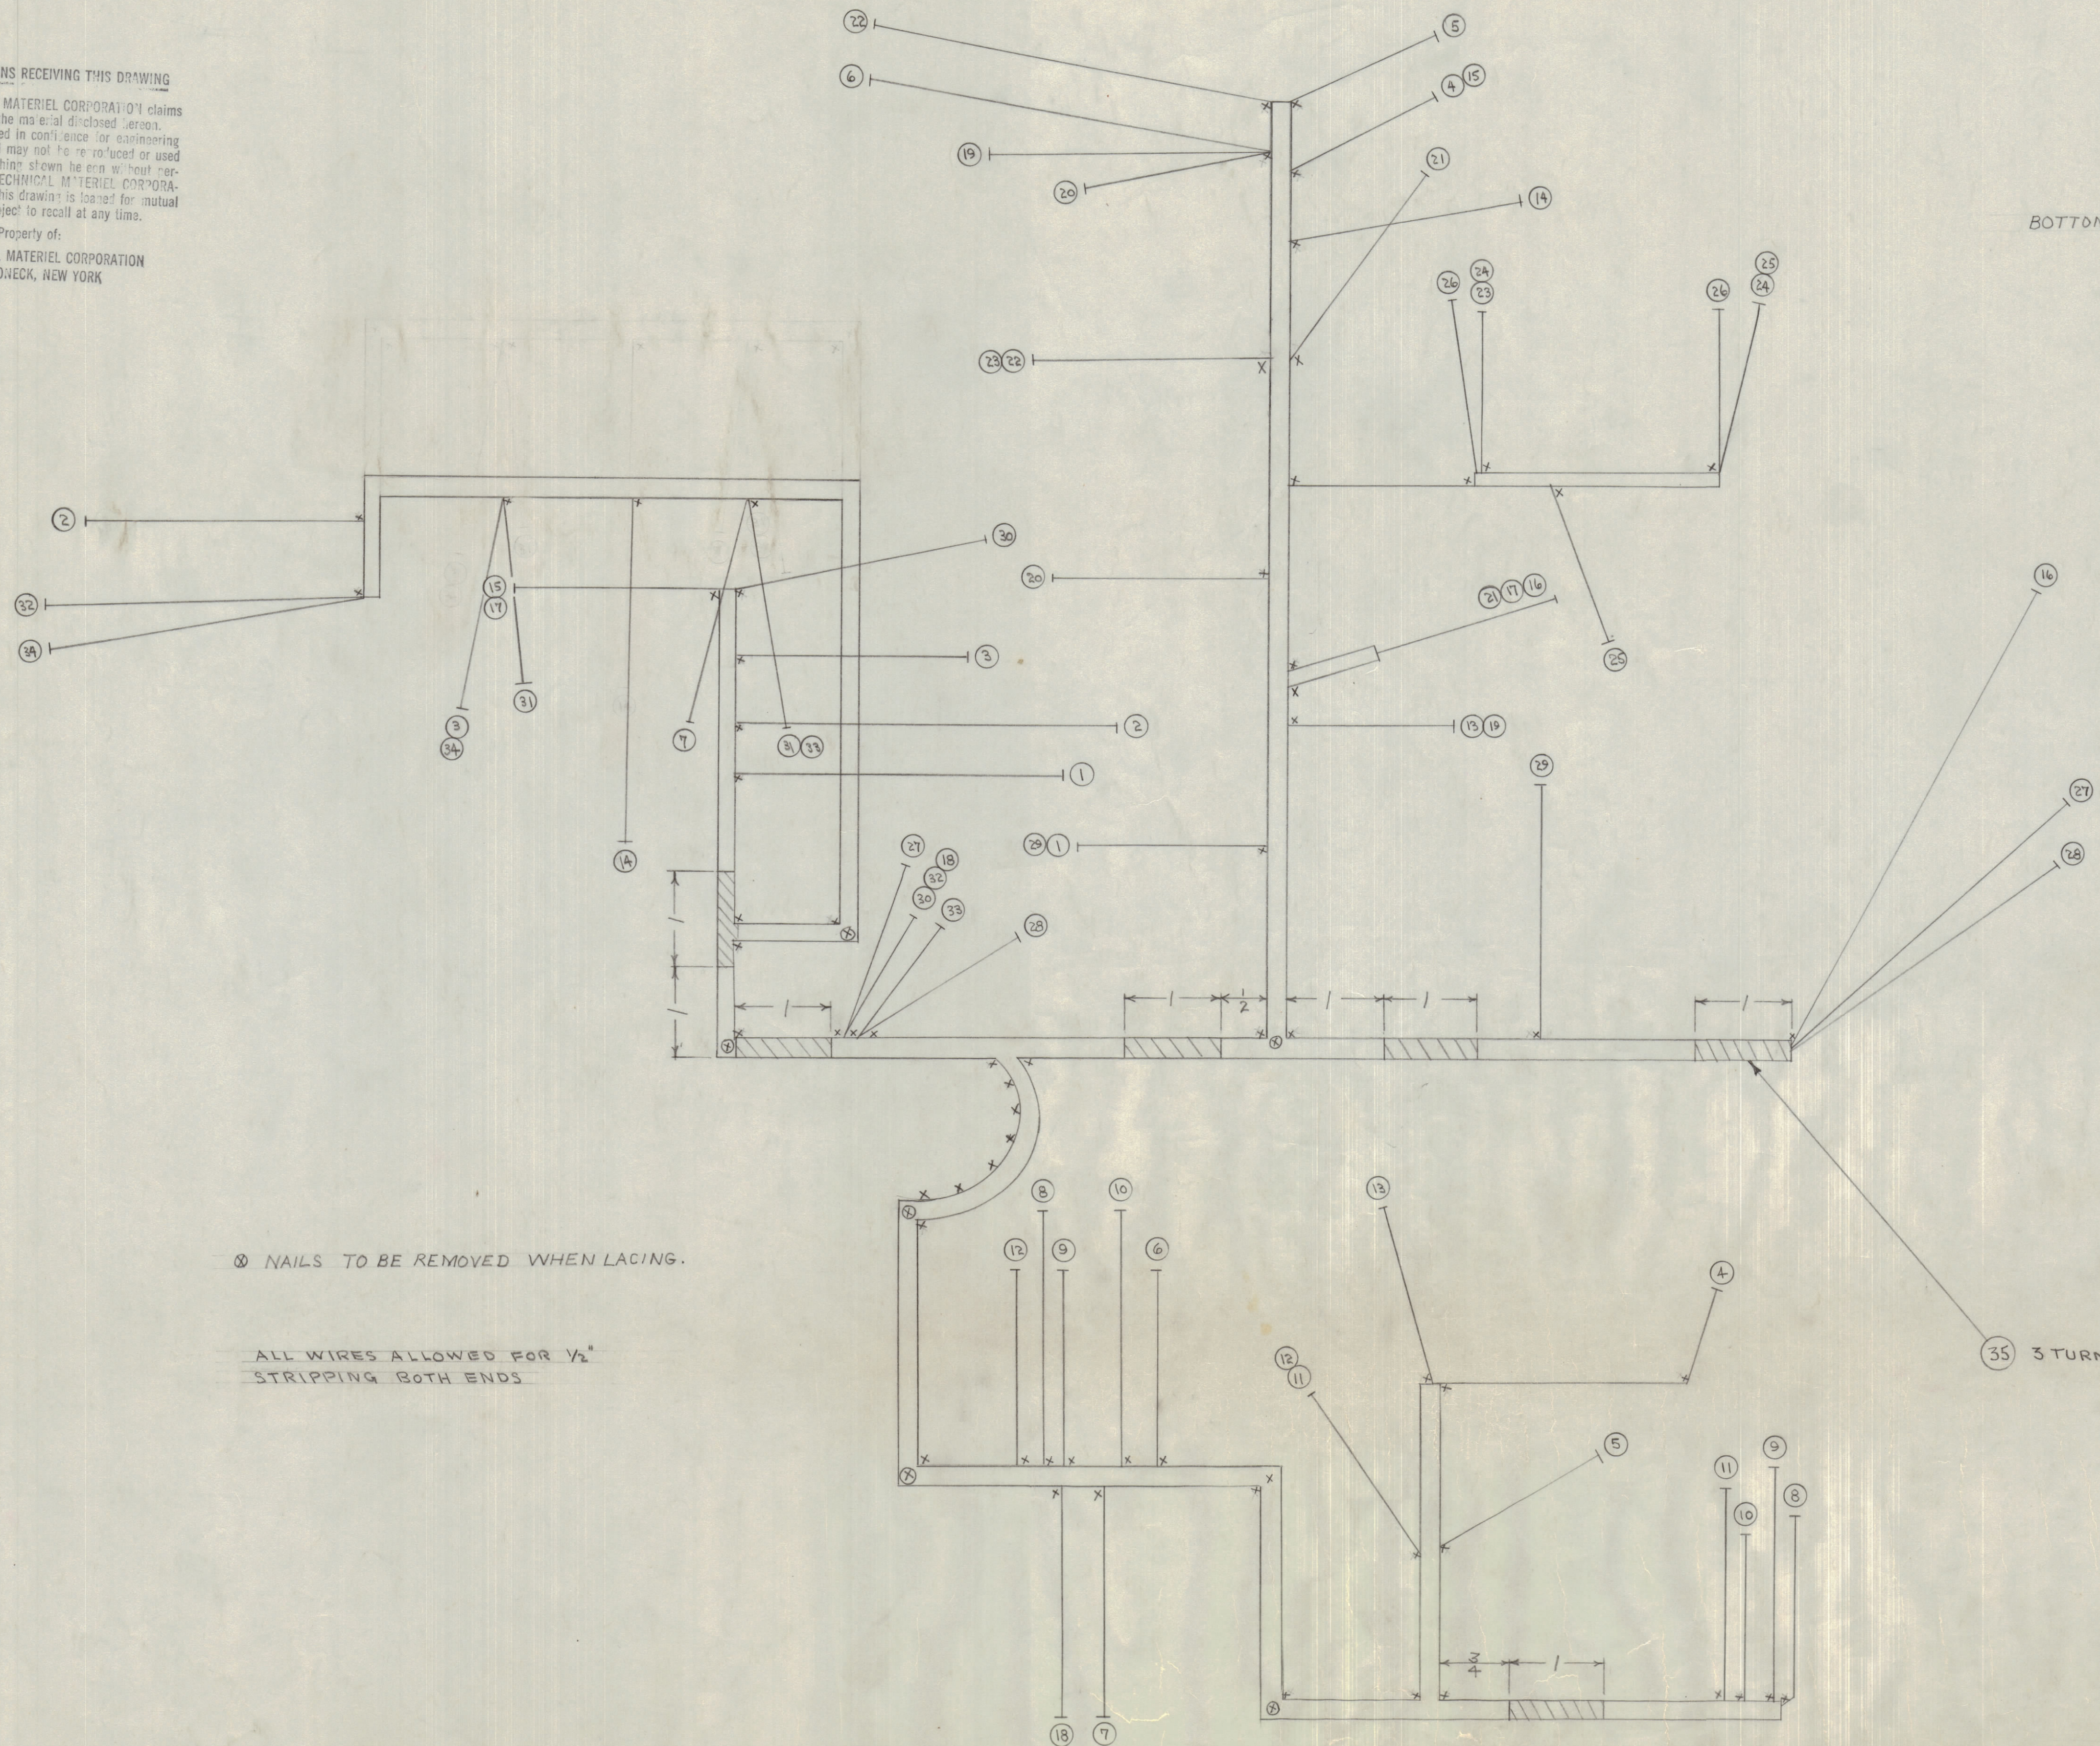

⊗ NAILS TO BE REMOVED WHEN LACING.

ALL WIRES ALLOWED FOR 1/2\"/>

10'	X	CD-100-1	CORD LACING - NYLON
7"	35	TA-100-4	TAPE, VINYL PLASTIC
9"	34	SRIR(1)20U22	CABLE, INSULATED (RED)
1'2 1/2"	33	SRIR(1)20U77	CABLE, INSULATED (VIOLET)

1'8 1/2"	37	SRIR(1)20U88	CABLE, INSULATED (GREY)
8 1/2"	31	SRIR(1)20U77	CABLE, INSULATED (VIOLET)
11 1/2"	30	SRIR(1)20U88	CABLE, INSULATED (GREY)
10 1/2"	29	SRIR 3/5(1)22U 11	CABLE, INSULATED (BROWN)
1'4 1/2"	28	SRIR(1)20U 44	CABLE, INSULATED (YELLOW)
1'5 1/2"	27	SRIR 1(1)20U 33	CABLE, INSULATED (ORANGE)
7 1/4"	26	SRIR 1(1)20U 44	CABLE, INSULATED (YELLOW)
6 1/2"	25	SRIR 3/5(1)22U-11	CABLE, INSULATED (BROWN)
7 1/4"	24	SRIR 3/5(1)22U 11	CABLE, INSULATED (BROWN)
9"	23	SRIR 3/5(1)22U 11	CABLE, INSULATED (BROWN)
10 3/8"	22	SRIR 3/6(1)22U 11	CABLE, INSULATED (BROWN)
9 7/8"	21	SRIR 1(1)20U 55	CABLE, INSULATED (GREEN)
10"	20	SRIR 1(1)20U 44	CABLE, INSULATED (YELLOW)
1'	19	SRIR 1(1)20U 22	CABLE, INSULATED (RED)
1' 1/4"	18	SRIR 1(1)20U 88	CABLE, INSULATED (GREY)
1'8 1/2"	17	SRIR 1(1)20U 55	CABLE, INSULATED (GREEN)
1'6 1/2"	16	SRIR 1(1)20U 55	CABLE, INSULATED (GREEN)
2' 1"	15	SRIR 1(1)20U 55	CABLE, INSULATED (GREEN)
2'6 1/2"	14	SRIR 1(1)20U 99	CABLE, INSULATED (WHITE)
2' 4"	13	SRIR 1(1)20U 22	CABLE, INSULATED (RED)
1' 1/4"	12	SRIR 1(1)20U 77	CABLE, INSULATED (VIOLET)
1'6 1/2"	11	SRIR 1(1)20U 77	CABLE, INSULATED (VIOLET)
1'2 1/4"	10	SRIR 1(1)20U 22	CABLE, INSULATED (RED)
1'3 1/4"	9	SRIR 3/5(1)22U 11	CABLE, INSULATED (BROWN)
1'4"	8	SRIR 1(1)20U 66	CABLE, INSULATED (BLUE)
1'10 1/2"	7	SRIR 1(1)20U 33	CABLE, INSULATED (ORANGE)
2' 3/4"	6	SRIR 3/5(1)22U 11	CABLE, INSULATED (BROWN)
2' 7/8"	5	SRIR 1(1)20U 22	CABLE, INSULATED (RED)
2' 10 1/2"	4	SRIR 1(1)20U 55	CABLE, INSULATED (GREEN)
1' 7/8"	3	SRIR 1(1)20U 22	CABLE, INSULATED (RED)
1' 11"	2	SRIR 1(1)20U 33	CABLE, INSULATED (ORANGE)
1'5"	1	SRIR 3/5(1)22U 11	CABLE, INSULATED (BROWN)

CA-129 A

REQ. ITEM	PART NO.	DESCRIPTION	SYMBOL
THE TECHNICAL MATERIEL CORP. MAMARONECK, NEW YORK			
CABLE HARNESS SUB ASSEMBLY			
STOCK SIZE		C.D.D. 10-6-52	
MATERIAL		DRAWN	
WEIGHT PER FC.		ELEC. DES. APP.	
TYPE & TEMPER.		MECH. DES. APP.	
HEAT TREAT. SPEC.		CHECKED	
FINISH & SPEC. NO.		FINAL APPROVAL	

LFA	143	A-200	10-6-52
MODEL	PROJECT NO.	ASSY. NO.	DATE
USED ON			

A	1	CHANGED FROM A-199	1/20/52	1	C.D.D.	ONE	ONE
ISSUE	ITEM	CHANGED FROM	DATE	CN. NO.	DRAFTS	CHECKER	ENG. APP.
TOLERANCES							
SCALE: FULL							
ALL DEC. DIM. ± 1/64				DRILL, PUNCH, COMMERCIAL STOCK SIZES AND MANUFACTURERS TOLERANCES ARE NOT INCLUDED.			
OTHERS ANGULAR DIM. ±							