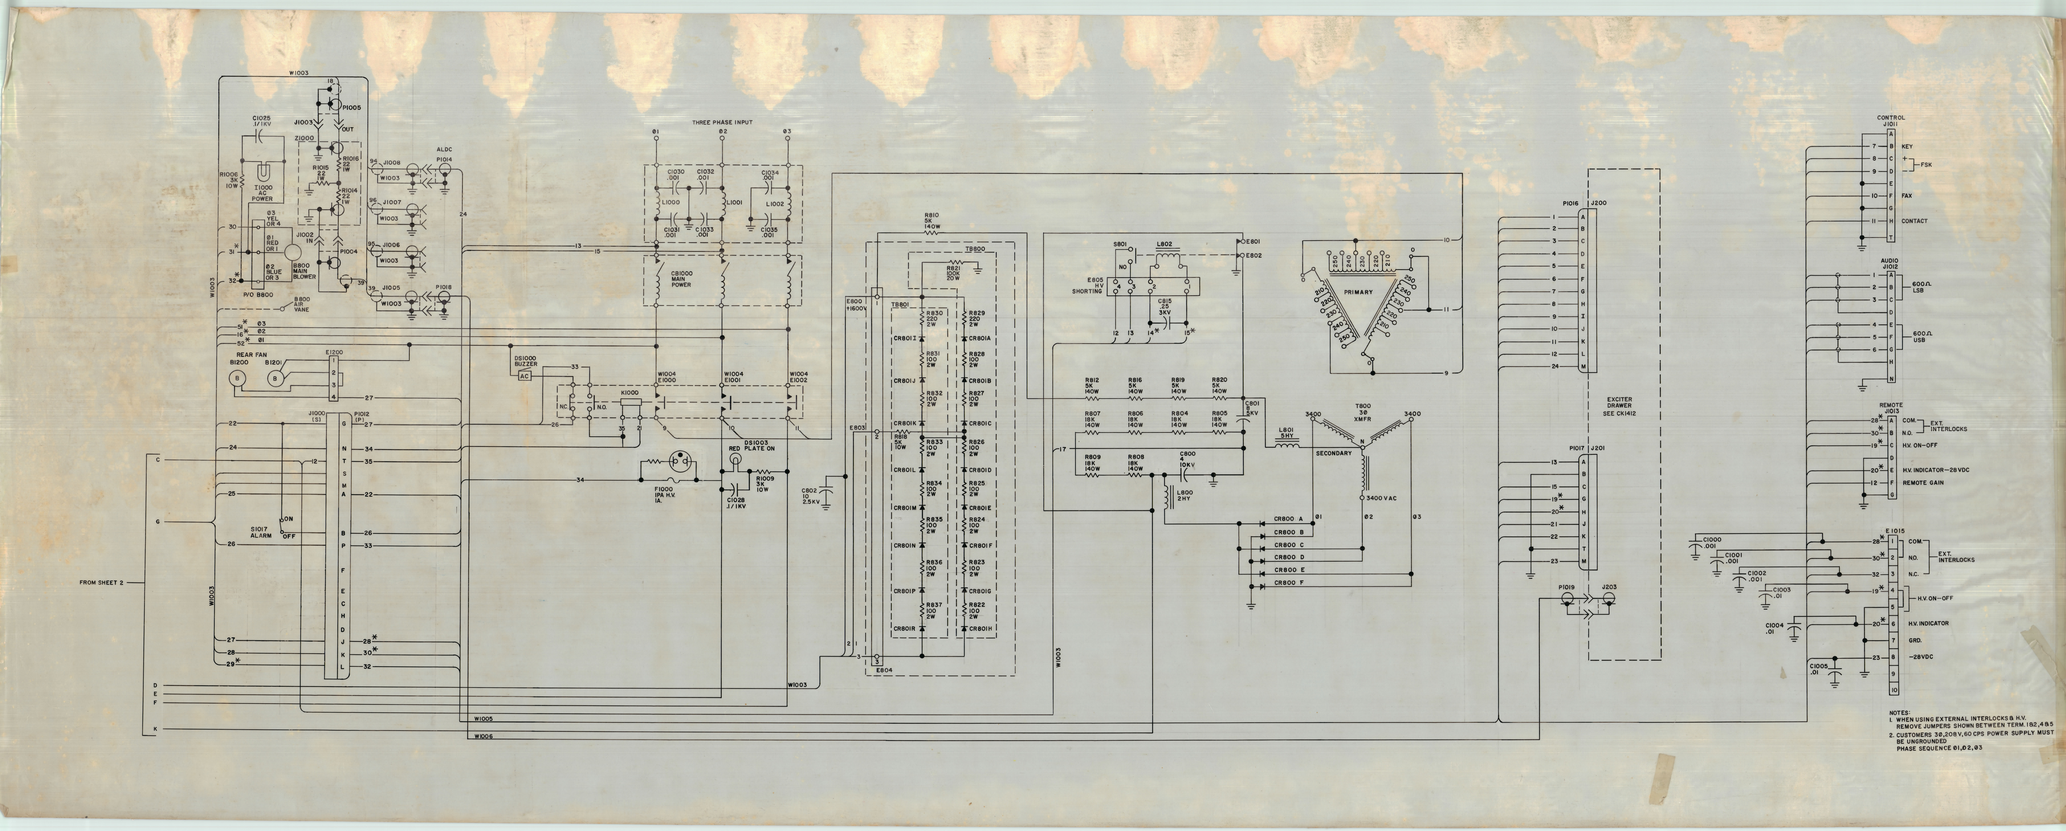

NOTES:
1. WHEN USING EXTERNAL INTERLOCKS & H.V. REMOVE JUMPERS SHOWN BETWEEN TERM. 182, 4 & 5
2. CUSTOMERS 3Φ, 208V, 60 CPS POWER SUPPLY MUST BE UNGROUNDED
PHASE SEQUENCE Ø1, Ø2, Ø3

ZONE	LTR	REVISIONS DESCRIPTION	DATE	ANSI/CHART	DRAWN	APPD
	A	EXPERIMENTAL RELEASE	1-2-61			
	B	REV. TO MATCH	7-26-61			
	C	DIAGRAM, SCHEMATIC, PART NO. CHANGE	7-26-61			
	D	SHEET 2 OF 3	1-4-62			
	E	SHEET 3 OF 3	1-4-62			
	F	CHANGE LEAD NAME TO CONNECTION NUMBER	1-8-62			

SYMBOL IDENTIFICATION		
SERIES	DESCRIPTION	MODEL
100	RELAY PANEL	AR-188-2
800	MAIN POWER SUPPLY	
1000	MAIN FRAME ASSEMBLY	
1200	POWER AMPLIFIER SECTION	
1250	DIRECTIONAL COUPLER	AX-569
2000	R.F. AMPLIFIER	VLLA

700 SERIES	
LAST SYMBOLS	MISSING SYMBOLS
C703	
C711	
C1705	
F701	
J701	
R705	
R702	
P701	

800 SERIES	
LAST SYMBOLS	MISSING SYMBOLS
R800	
C815	
CR801R	
E805	
L805	
R807	
T801	CR801 R04, R09, R08, R07, R06, R05, R12, R17, R12
T801	R802 R01, R02, R03, R11, R13, R14, R15, R17

1000 SERIES	
LAST SYMBOLS	MISSING SYMBOLS
C1009	C1006, 1007, 1008, 1009, 1010, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1021, 1022, 1023, 1024, 1031
C81001	
R81001	R81002, 1005, 1006, 1007,
E1013	E1003, 1004, 1005, 1007, 1008, 1009, 1010, 1012
J1010	J1008, 1012
R1006	
R1008	
L1002	
M1005	M1000, 1002
P1008	P1000, 1010, 1011, 1013, 1015
S1010	S1009
T1001	
W1006	
F1000	
R1015	

1200 SERIES	
LAST SYMBOLS	MISSING SYMBOLS
R1201	
C1232	
CR1200	
E1213	
J1212	J1200
R1200	L1200, 1210
L1205	
M1201	
P1201	P1200
P1210	
P 1210	
R1204	S1200
T1201	
T01200	
V1204	
F1200	

1250 SERIES	
LAST SYMBOLS	MISSING SYMBOLS
R1251	C-1000
CR1251	
E1250	
F1250	
J1250	
K1250	
L1251	
Q1250	
R1251	
T1251	

2000 SERIES	
LAST SYMBOLS	MISSING SYMBOLS
R2001	R2000
C2040	C2000, 2021
CR2000	CR2000
E2051	E2002, 10, 2016
F2009	F2000
J2002	
K2001	K2000
L2018	L2000
M2001	M2000
P2004	P2000
R2004	
T2006	R2000
T2005	T2000
V2001	V2000
V02000	

NOTES:
UNLESS OTHERWISE SPECIFIED:
1. ALL RESISTORS ARE IN OHMS, 1/2 WATT ± 10% MILLION
2. ALL CAPACITORS ARE IN MICROFARADS UNF-MICRO MICROFARADS
3. ALL COILS ARE IN MILLIHENRY OHM-MICROHENRY
4. ALL ROTARY SWITCHES ARE SHOWN IN POSITION ONE
5. FUSES



6. ON S2004, S800, S1006, S1007, S1008, S1009, S1010, S1012, S1202 AND S1206 OF INTERLOCK CIRCUIT TERMINAL NO. 1 DESIGNATES SWITCH TERMINAL MARKED "HOT" TERMINAL NO. 2 DESIGNATES SWITCH TERMINAL MARKED "NC"
ALL ABOVE SWITCHES ARE DIAGRAMMATICALLY SHOWN IN THE NORMALLY OPERATED POSITION
7. TERMINALS MORE THAN ONE CONNECTION ON THE LINE

QTY REQ	ITEM	PART NO.	DESCRIPTION	SYMBOL
			LIST OF MATERIAL	

BUDETTI

THE TECHNICAL MATERIEL CORP.
MAMARONECK, NEW YORK

DIAGRAM, SCHEMATIC
GPT-10KLFE

J. WACHMAN 1-2-62

SIZE C | CODE IDENT NO. 82679 | DWG NO. CK1430 | ISSUE C

SCALE — | SHEET 3 OF 3