


REQ. PER UNIT	1
MODEL	GPT-200K
ASSY. NO.	AP-108
DATE	10-23-63
USED ON	DD-110

SPECIFICATIONS:
 AMP ~ 1.6 DC
 P.I.V. ~ 8 KV

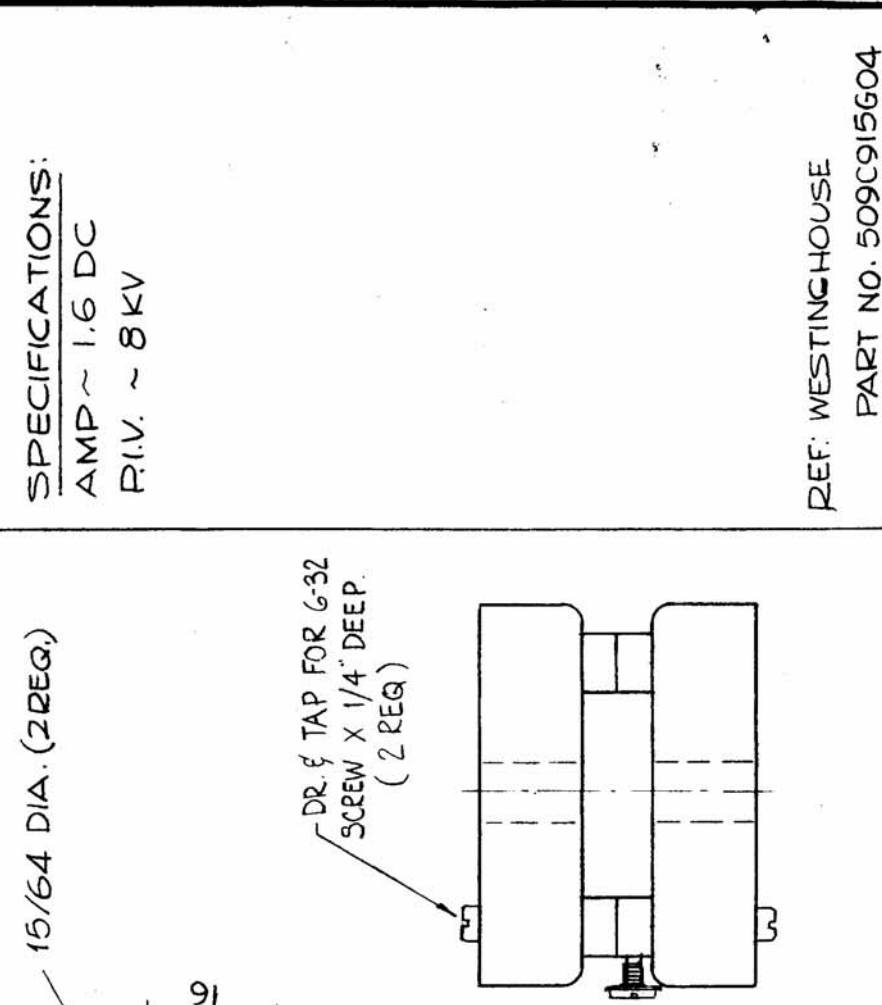

REQ. ITEM		PART NO.	F. BUDETTI	DESCRIPTION	SYMBOL
				THE TECHNICAL MATERIEL CORP. MAMARONECK, NEW YORK	
				RECTIFIER, SEMI-CONDUCTOR DEVICE (FULL WAVE CENTER TAP)	
				SPG	
				DRWN	
				CHKD	
				APP	
				FINAL APPROVAL	
				ELEC. DES. APP.	
				MECH. DES. APP.	
				DD-110	

SYM		DATE	3-3-64	CH. NO.		DRAFTS	A.M.	CHECKER		ENG. APP.	
		DESCRIPTION		SCALE	1" = 1"						
		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND INCLUDE CHEMICALLY APPLIED OR PLATED FINISHES									
		FRACTIONS									
		TOLERANCES									
		DECIMALS									
		.X ± .05									
		.XX ± .01									
		.XXX ± .005									
		ANGLES									
		± 1/64									
		± 0° 30'									
		CODE	C								
		FINISH & SPEC. NO.									