


IF IT IS FOUND DESIRABLE TO CHANGE ANY TOLERANCE OR OTHER DETAIL SPECIFIED ON THIS DRAWING NOTIFY THE PURCHASER PROMPTLY.

MAXIMUM ALLOWABLE TOLERANCES HAVE BEEN DETERMINED AND DEVIATIONS WILL BE CAUSE FOR REJECTION. REMOVE ALL BURRS AND SHARP EDGES

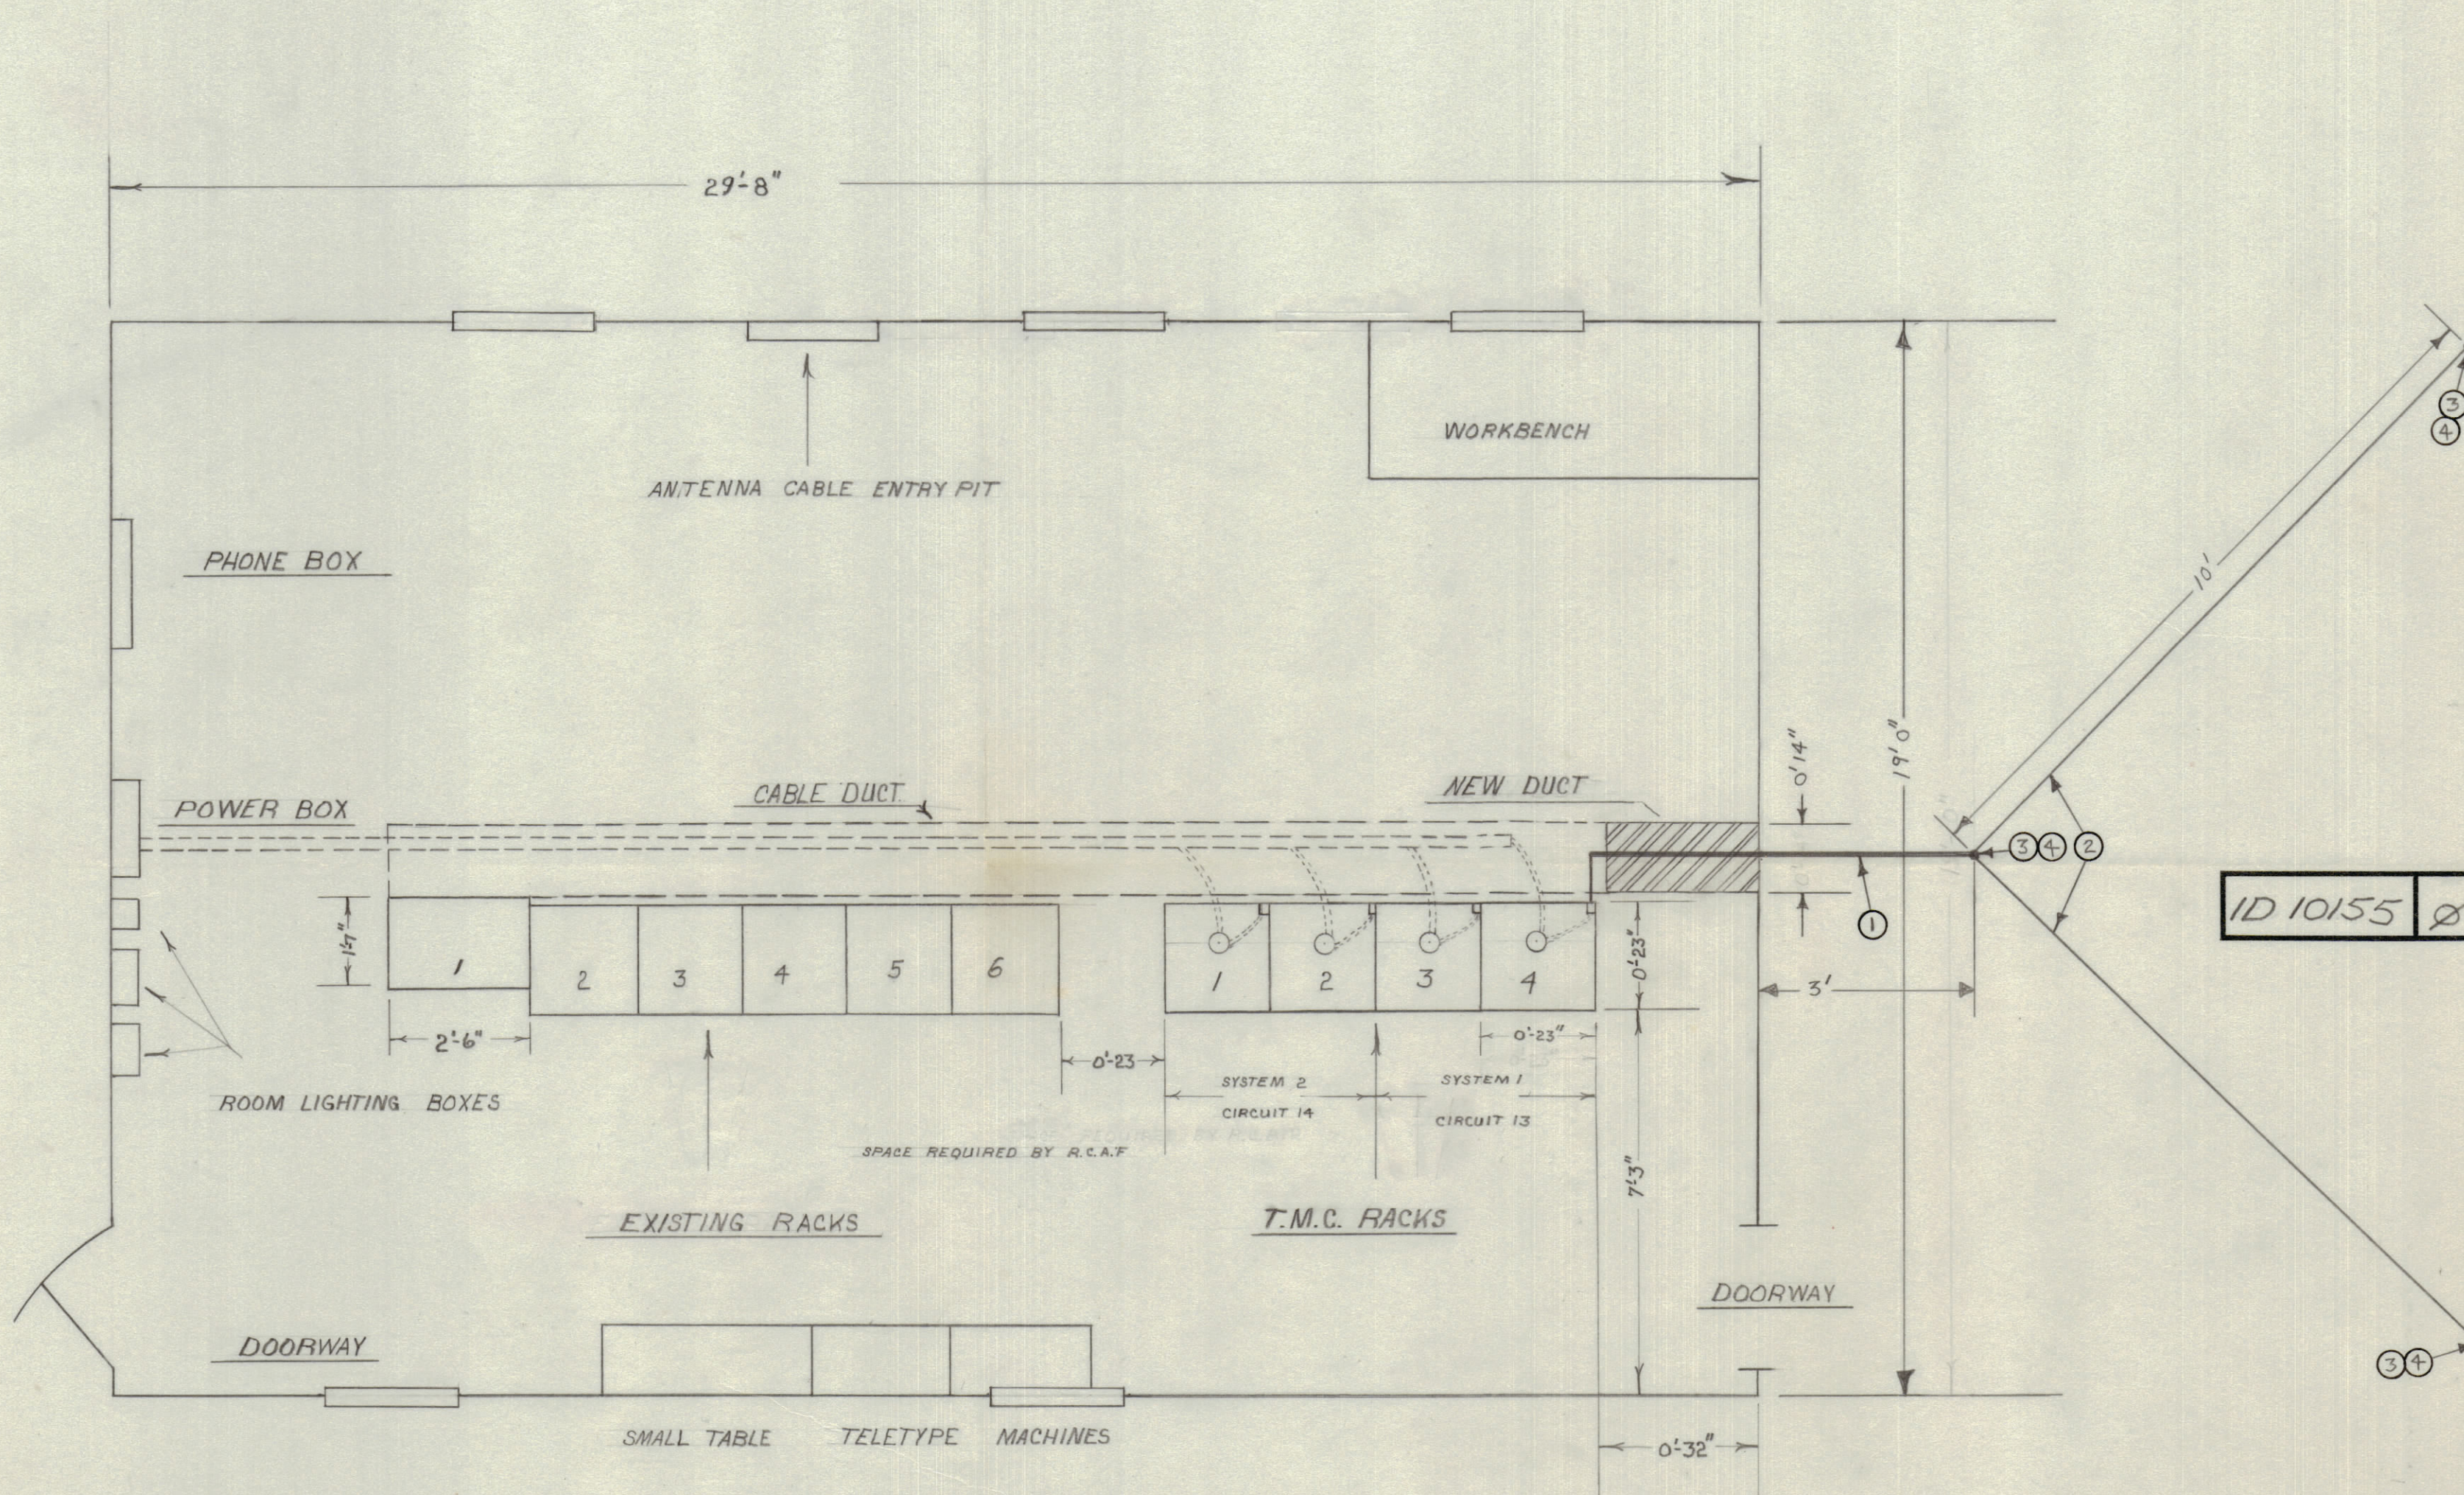

ID 10155  $\phi$

4	SLATER #7787	CLAMPS	
3	SLATER #9430	GROUND RODS	
10'	2	#6 MED. HARD DRAWN COPPER WIRE	
1		1" X 1/8" SOLID COPPER BUS	
REQ. ITEM	PART NO.	DESCRIPTION	SYMBOL

**TMC (Canada) LIMITED**  
 OTTAWA ONTARIO  
 POWER DISTRIBUTION/GROUND SYSTEM  
 WESTHAM ISLAND AIRBASE  
*M. Johnson*  
 DRAWN ELEC. DES. APP. MECH. DES. APP.  
 CHECKED FINAL APPROVAL  
 ID-10155  $\phi$

ISSUE	ITEM	CHANGED FROM	DATE	CN. NO.	DRAFTS	CHECKER	ENG. APP.
TOLERANCES							
SCALE: 0'-1/2" = 1'0"							
ALL OTHERS		DEC. DIM. $\pm$ FRAC. DIM. $\pm$ ANGULAR DIM. $\pm$		DRILL, PUNCH, COMMERCIAL STOCK SIZES AND MANUFACTURERS TOLERANCES ARE NOT INCLUDED.			

MODEL	PROJECT NO.	ASS'Y. NO.	DATE
USED ON			