



REVISIONS						
SYM	ZONE	DESCRIPTION	DATE	E.M.N. NO.	DRAFT	CHKD
A		REVISED	9/21/65		MJT	
B		22 5/8 DIM. WAS 23 1/2" ADDED TECH DATA. SEE SH 4 & 5	6/1/66	16315	C.H.	<i>[Signature]</i>

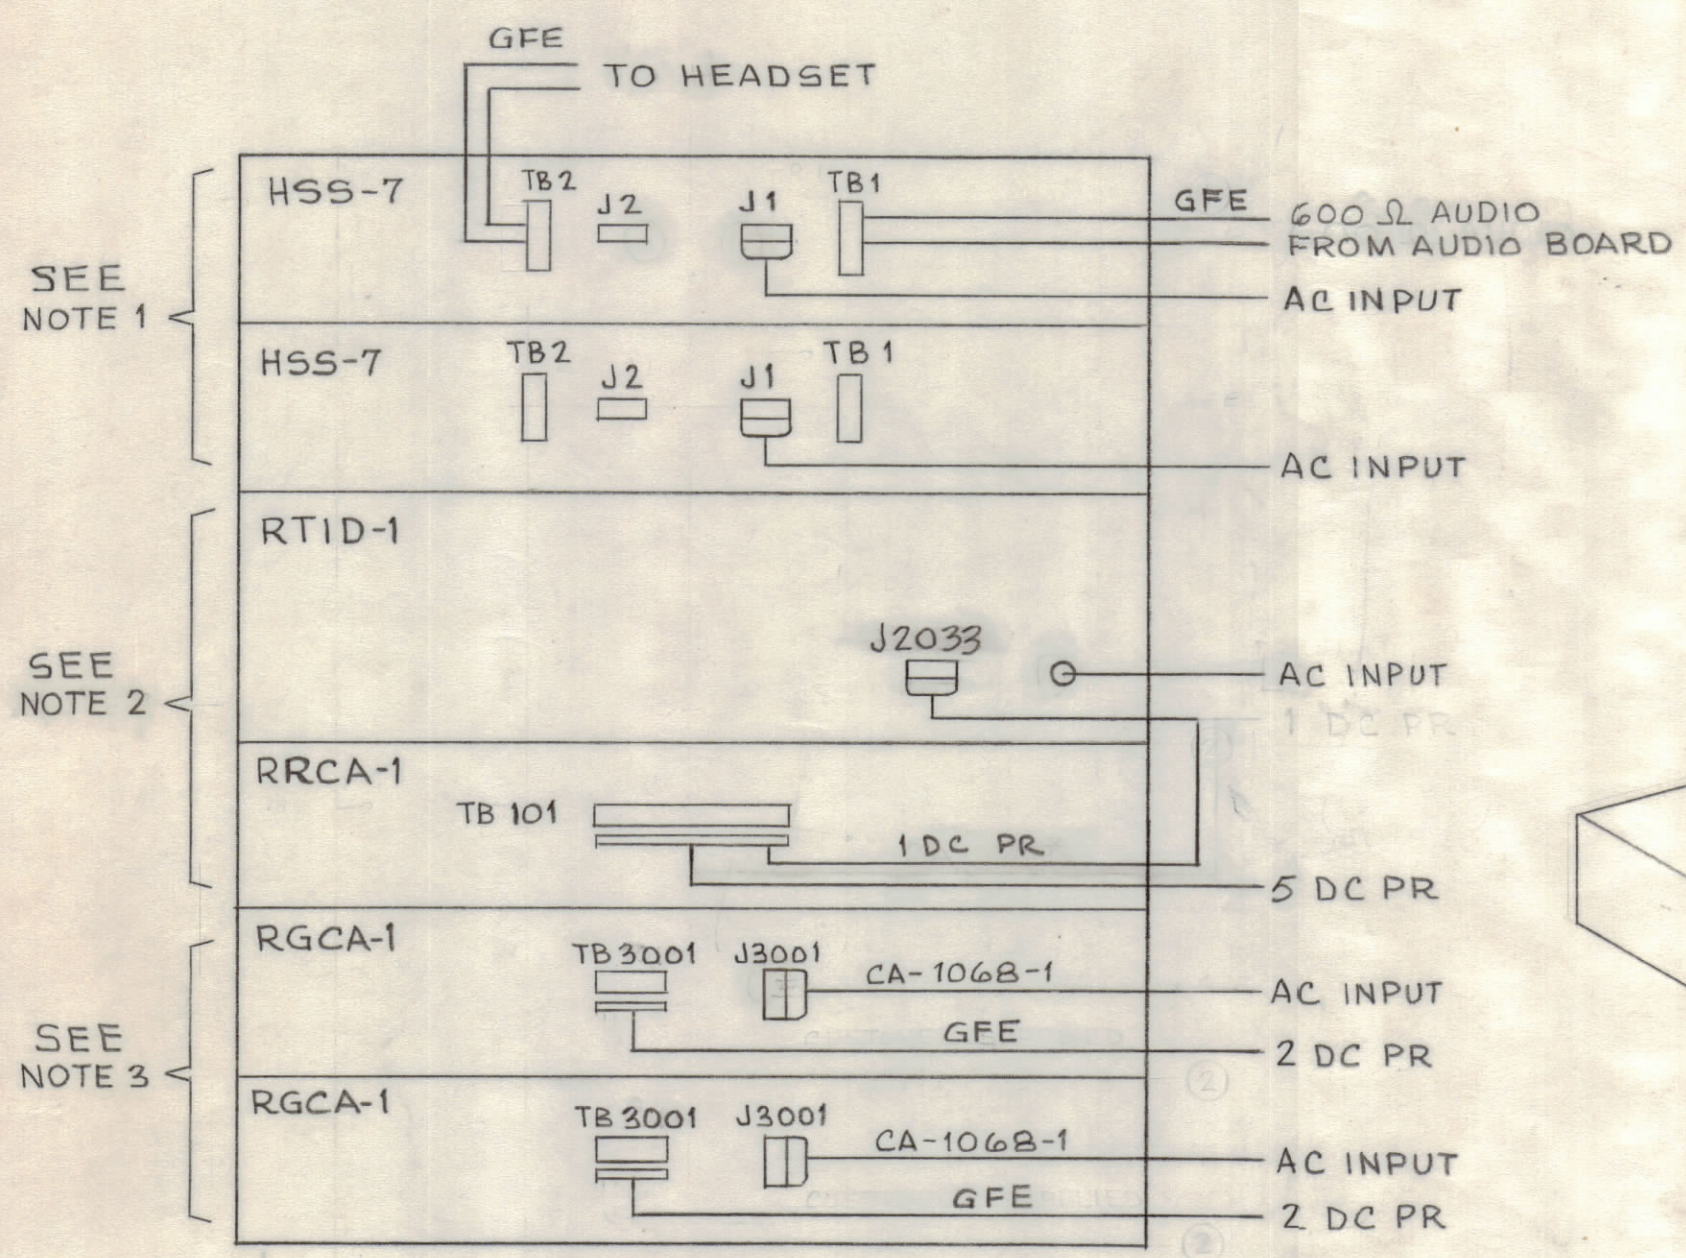

REAR VIEW

FUNCTIONAL INTERCONNECTION DIAGRAM

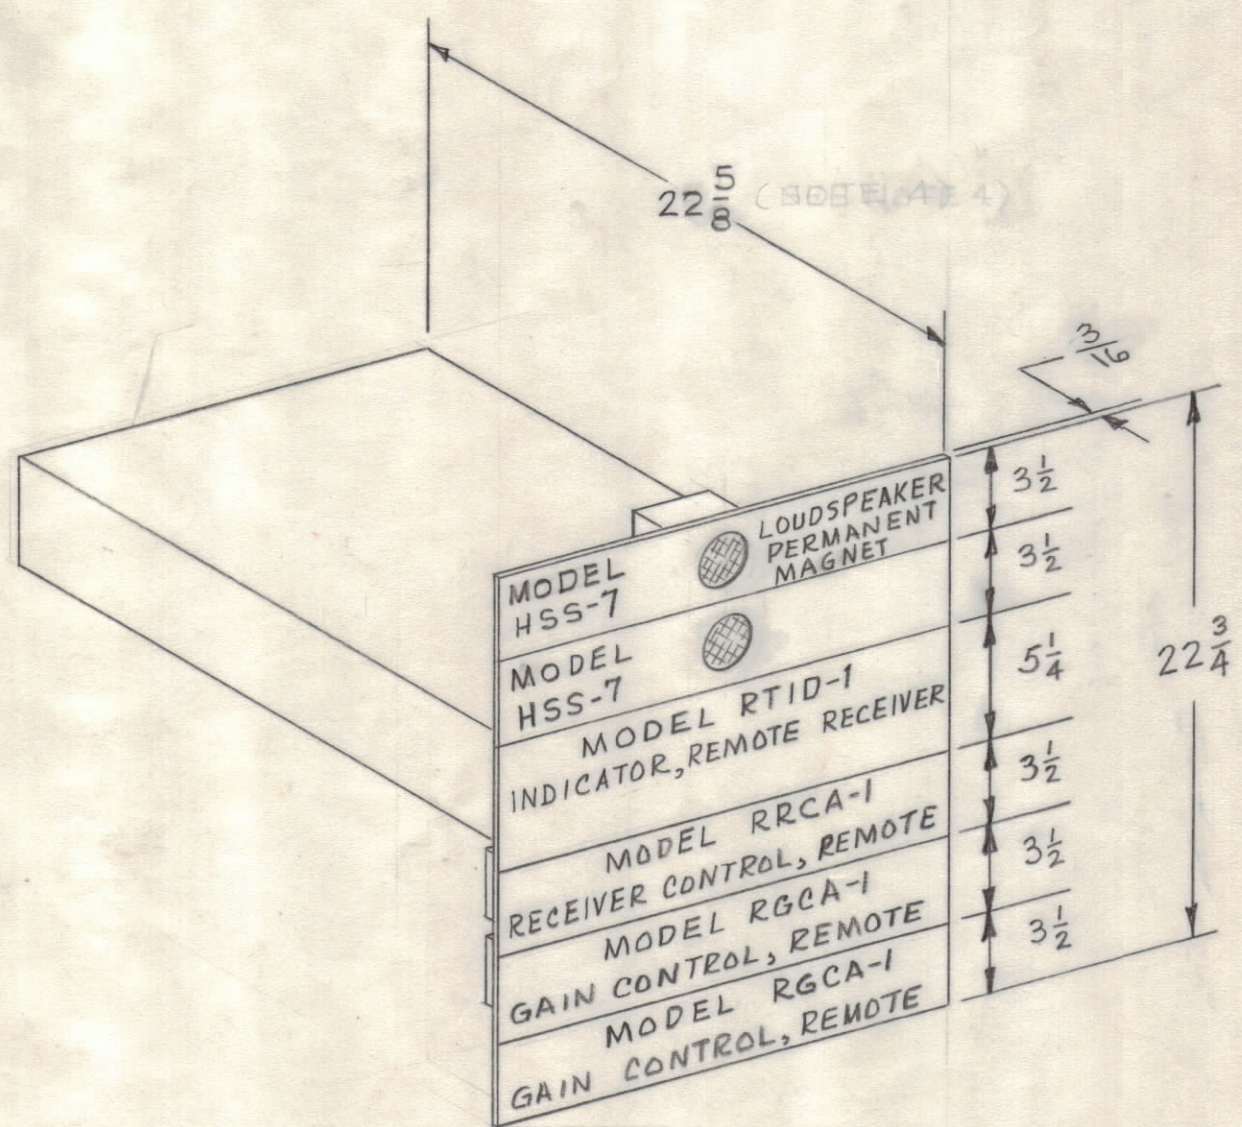

TECHNICAL DATA

POWER INPUT	124 WATTS
VOLTAGE	115/230 VAC
PHASE	SINGLE ϕ
FREQUENCY	50/60 CPS
HEAT DISSIPATION	124 W, 422 BTU/HR
AMBIENT TEMP. RANGE	0° TO 50°C
RELATIVE HUMIDITY	0 TO 90%
WEIGHT	102 LBS

CABLE RECOMMENDED

- ① TTRS-2 (1 SPARE)
- ② TTRS-6 (1 SPARE)

NOTES:

1. SEE SHEET 2.
2. SEE SHEET 3 AND 4
3. SEE SHEET 5
4. SEE SHEET 6 FOR INSTALLATION MATERIAL LIST
5. FOR CABLING DETAIL SEE ID-325 SHEET 4

MAXIMUM ALLOWABLE TOLERANCES HAVE BEEN DETERMINED AND ANY DEVIATIONS WILL BE CAUSE FOR REJECTION.

QTY REQ	ITEM	PART NO.	DESCRIPTION	SYMBOL
BILL OF MATERIAL				
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ON FRACTIONS DECIMALS ANGLES $\pm 1/64$ $\pm .005$ $\pm 1/2^\circ$				
FINAL APPROVAL		DATE	THE TECHNICAL MATERIEL CORP. MAMARONECK, NEW YORK	
MECH. DES.		DATE		
ELECT. DES.		DATE		
CHECKED		DATE		
DRAWN		DATE		
MATERIAL			CONTROL MONITOR GROUP, MODEL RCWB-1	
FINISH		APPROVED FOR BUSHIPS	CODE	SIZE
			82679	C
		CONTRACT NO.	DWG. NO.	
		N600(63133-11-126) 63002	ID-325	
			SCALE	ISSUE
			NONE	B
			SHEET 1 OF 6	